

1. All construction shall be in accordance with the City of SeaTac Municipal Code (SMC), the 2016 King County Road Standards (KCRS) as amended by the City of SeaTac Addendum to Road Standards, the latest version of the King County Surface Water Design Manual (KCSWDM) as amended by the City of SeaTac Addendum to the KCSWDM, and the latest version of the Washington State Department of Transportation (WSDOT) Standard Specifications for Roads, Bridges, and Municipal Construction and all conditions of the permits and land use actions. It shall be the sole responsibility of the applicant and the professional civil engineer to correct any error, omission, or variation from the above requirements found in these plans. All corrections shall be at no additional cost or liability to City of SeaTac. The design elements within the plans have been reviewed according to the SeaTac Engineering Review Division checklist. Some elements may have been overlooked or missed by the Engineering Review Division plans reviewer. Any variance from adopted standards is not allowed unless specifically approved by the Engineering Review Manager in writing prior to construction.
2. The design elements within these plans have been reviewed according to the City of SeaTac Engineering Review Division checklist. Some elements may have been overlooked or missed by the Engineering Review Division plans reviewer. Any variance from the City of SeaTac's adopted standards is not allowed unless specifically approved by the Engineering Review Division manager prior to construction.
3. Approval of the work described as part of this permit and shown in the plans does not constitute an approval of any other construction (domestic water conveyance, sewer conveyance, gas, electrical, etc.). All work shown on these plans need to be permitted by the City of SeaTac Engineering Review Division prior to the start of construction. More than one permit may be necessary for the work shown.
4. A preconstruction meeting must be held between the City of SeaTac Engineering Review Division, the applicant, the applicant's construction representative, and representatives from the various utilities being constructed or affected by these plans on-site or at City Hall no later than 72 hours prior to start of on-site construction. Call the City of SeaTac Engineering Review Division administrative number at 206.973.4764 to arrange a time for our representative to meet with the contractor, sub-contractors, and utility representatives. All contractors and sub-contractors will need to show proof of State L & I contractors' registration and city business license at the pre-construction meeting.
5. A copy of the latest approved plans, permits, and all associated documents must be on the job site at all times during construction.
6. It shall be the applicant's/contractor's responsibility to obtain all applicable construction easements necessary before initiating work on private property.
7. Groundwater encountered during excavation shall be disposed of per section 7-08 of the WSDOT standard specifications.
8. All roadway subgrade shall be backfilled and compacted to 95 percent density (WSDOT 2-06.3).
9. Open cutting of existing roadways is not allowed unless specifically approved by City of SeaTac Public Works Director or designee and noted on these approved plans.
10. When there is no active construction activity, trenching in the roadway must be covered with steel plates and the lanes reopened. Each side of the plate shall have a minimum of 12 inches bearing on the sides of a cut, and shall be anchored by steel pins shimmed to prevent movement, and oriented to be perpendicular to traffic. Plates shall be bedded on temporary pavement patch material and the bedding shall be tapered on all sides to provide smooth transition for all users. Plates shall be textured to provide a non-skid surface in dry and wet conditions. All plates shall be highlighted with paint, and an advance warning sign shall be used to identify the presence of the plate.
11. The contractor shall be responsible for providing adequate safeguards, safety devices, protective equipment, flaggers, and any other needed actions to protect the life, health, and safety of the public, and to protect property in connection with the performance of work covered by the contractor. Any work within the traveled right-of-way that may interrupt normal traffic flow shall require an approved traffic control plan. Section 1-07.23, "Traffic Control," of the WSDOT standard specifications shall apply in its entirety.
12. Construction noise shall be limited in accordance with SeaTac Municipal Code section 8.05.360. Normal working hours are from 7:00 a.m. to 4:00 p.m. Monday through Friday. On the following major arterials, however, hours of operation shall be limited from 8:30 a.m. to 3:00 p.m.: International Boulevard, Military Road South, Des Moines Memorial Drive South, 24th Avenue South, 28th Avenue South, S. 154th Street, S. 160th Street, S. 170th Street, S. 176th Street, and S. 188th Street, and S. 200th Street. Additional restrictions may apply based on SEPA conditions or specific site characteristics. Work outside the normal working hours, or on Saturdays (9:00 a.m. to 10:00 p.m.), Sundays (9:00 to 6:00 p.m.), and holidays, will require prior written approval from the Engineering Review Division. Requests for such after-hours, weekend, or holiday must be submitted to the Engineering Review Division 72 hours in advance of such work and must be approved in writing. City staff time for after-hours, Saturday, Sunday, and holiday work will be billed at the rate of one and one half times the standard hourly rate.
13. No lane closure or work will be allowed on the roads listed in item #14 during the times listed unless approved by the City of SeaTac Engineering Review Division:
  - From midnight 3 days prior to Thanksgiving to midnight Monday after Thanksgiving.
  - From midnight December 23<sup>rd</sup> or the Friday prior, if it occurs on a Saturday or Sunday, to midnight January 2<sup>nd</sup>, or the Monday after, if it falls on a Friday, Saturday or Sunday.
14. The contractor shall provide uniformed officers with marked police vehicles in accordance with the approved Traffic Control Plan(s). Contact the King County Police Officers' Guild to arrange for off duty officers. They can be reached by phone at 206-957-0934 or by email at [offduty@kcpog.com](mailto:offduty@kcpog.com). Officers from other counties may be substituted if the King County Police Officers' Guild cannot provide officers. Closure of a lane of traffic on the following arterials shall require the presence of an off-duty police officer with marked patrol vehicle as part of the Traffic Control Plan(s): International Boulevard; Military Road South; Des Moines Memorial Drive South; 24<sup>th</sup> Avenue South; 28<sup>th</sup> Avenue South; S. 154<sup>th</sup> Street; S. 160<sup>th</sup> Street; S. 170<sup>th</sup> Street; S. 176<sup>th</sup> Street; S. 188<sup>th</sup> Street; S. 200<sup>th</sup> Street; or any signalized intersection.
15. The standard coordinate system to be used for projects in SeaTac, unless otherwise approved by City of SeaTac Engineering Review Division, is: NAD, 1983 HARN, StatePlane\_Washington\_North, FIPS 4601\_Feet, WKID: 2926 Authority: EPSG, Washington State Plane Coordinates (North Zone), North American Datum of 1983 (1991) HARN, Spheroid GRS 1980, Vertical datum NAVD88, Linear units in U.S. Survey Feet", FIPS 4601 ("1 foot equals 0.3048006096 meters).
16. Upon completion of the project, a set of CAD produced As-Built drawings that are coordinately correct using city's horizontal and vertical control is to be prepared by a professional licensed surveyor or engineer. As built drawings are to be reviewed and approved by the City of SeaTac. Once approved by the City for accuracy, an electronic CAD file of the drawing shall be provided to the City of SeaTac for a permanent record.

1. All pipe and appurtenances shall be laid on a properly prepared foundation in accordance with WSDOT 7-02.3(1). Reductions in compaction requirements are allowed to accommodate bioretention or permeable pavement installations.
2. Steel pipe shall be galvanized and have asphalt treatment #1 or better inside and outside (KCRS 7.03).
3. All drainage structures, such as catch basins and manholes, shall have locking frames and grates or solid locking lids. All drainage structures associated with a permanent retention/detention facility shall have solid locking lids.
4. All catch basin grates shall conform to the latest edition of the KCRDCS drawing numbers 7-013, 7-017, 7-018, 7-019, 7-020, or 7-021, and shall include the stamping "Outfall to Stream, Dump No Pollutants". All grates and solid covers within the Right-of-Way shall have EON lock, Ergo round covers, or approved equivalent.
5. All driveway culverts located within City of SeaTac Right-of-Way shall be of sufficient length to provide a minimum 3:1 slope from the edge of the driveway to the bottom of the ditch. Driveway culverts shall be 12" diameter concrete or equivalent with beveled end sections on all exposed ends to match the side slope, and are to have quarry spalls for erosion protection on each end (see KCRS 7.03(g), Drawing No. 7-001).
6. The standard rock lining of ditches shall be in accordance with the most recent edition of the King County Surface Water Design Manual and section 9-13 of the WSDOT standard specifications. Rock gradation shall be as follows: passing 8-inch square sieve 100%; passing 3-inch square sieve 40%; and passing ¾ inch sieve 10%. Installation shall be placed so as to form a firm, dense protective mat consistent with examples in KCRDCS drawing number 7-024 and conforming to the design surface of the ditch. Individual rocks shall not protrude more than 3 inches from that surface.
7. All storm pipe, detention tanks & vaults, water quality tanks & vaults, and combined detention & water quality tanks & vaults shall be subject to testing per section 7-04 of the WSDOT standard specifications and City of SeaTac standard procedures.
8. Detention tanks must pass an exfiltration test per the WSDOT 2016 7-04.3(1)b standard prior to finalizing the STE permit.
9. All disturbed pervious areas (compacted, graded, landscaped, etc.) of the development site must demonstrate one of the following: the existing duff layer shall be staged and redistributed to maintain the moisture capacity of the soil, or amended soil shall be added to maintain the moisture capacity pursuant to City of SeaTac soil amendment standards.
10. Site clearing is limited seasonally between October 1 and March 30 inclusive, unless otherwise approved with a written decision by the City of SeaTac Engineering Review Division.
11. Prior to the construction of any improvements and/or buildings on the site, those portions of the stormwater facilities necessary to accommodate the control of surface and stormwater runoff discharge from the site during construction must be constructed, approved, and functioning properly.
12. Drainage inlets (stub-outs) shall be provided for each individual lot, except for those lots approved for infiltration by the City of SeaTac. Stub-outs shall conform to the following:
  - a) Each outlet shall be suitably located at the lowest elevation on the lot, so as to service all future roof downspouts and footing drains, driveways, yard drains, and any other surface or subsurface drains necessary to render the lots suitable for their intended use. Each outlet shall have free, flowing, positive drainage to an approved stormwater conveyance system or to an approved outfall location.
  - b) Outlets on each lot shall be located with a five-foot-high, 2" x 4" stake marked "storm" or "drain". The stake shall extend above surface level, be visible, and be secured to the stub-out.
  - c) Pipe material shall conform to underdrain specifications described in KCRS 7.03. If non-metallic, the pipe shall contain wire or other acceptable detection.
  - d) Drainage easements are required for drainage systems designed to convey flows through individual lots.
  - e) The applicant/contractor is responsible for coordinating the locations of all stub-out conveyance lines with respect to utilities (e.g., power, gas, telephone, television, etc.).
  - f) All individual stub-outs shall be privately owned and maintained by the lot homeowner.
13. Pipe cover notes:
  - a) For cover less than 1 ft. ductile iron pipe is used.
  - b) For cover from 1 ft. to 2 ft. use reinforced concrete pipe.
  - c) For a min. 2 ft. cover - any material listed in the 2016 King County Surface Water Design Manual other than PVC may be used.
  - d) PVC pipe requires at least 3 ft. cover.
  - e) All PVC pipes require a sand collar when connecting to a concrete structure.

Notes: All dimensions are measured from top (outside) of pipe. a) Cover is the material over the outside top of the pipe (cover may not include the material of the pipe). If you have a three-foot grade differential between the invert of a 12" diameter pipe and the finished grade, you do not have two foot of cover over the pipe. Exceptions may be granted in non-vehicular areas.


14. The Contractor shall provide CCTV footage of all pipes installed in Right-of-Way to the City.

1. The approved Stormwater Erosion and Sediment Control/Pollution Prevention Plan (ESC/SWPPP), if required, must be kept on the construction site at all times.
2. Approval of the erosion and sediment control (ESC) measures shown in the approved plans does not constitute an approval of permanent road or drainage design (e.g., size and location of roads, pipes, restrictors, channels, retention facilities, LID BMPs, utilities, etc.) unless that is also covered by this permit.
3. The implementation of these ESC plans and the construction, maintenance, replacement, and upgrading of these ESC BMPs is the responsibility of the applicant/ESC supervisor until all construction is approved.
4. The boundaries of the clearing limits shown on this plan shall be clearly flagged by survey tape or fencing, prior to construction (SWDM Appendix D as amended by the City of SeaTac addendum to the KCSWDM), unless specifically allowed by the City Inspector. During the construction period, no disturbance beyond the clearing limits shall be permitted. The clearing limits shall be maintained by the applicant/ESC supervisor for the duration of construction.
5. Stabilized construction entrances shall be installed at the beginning of construction and maintained for the duration of the project. Additional BMPs, such as constructed wheel wash systems or wash pads, may be required to ensure that all paved areas are kept clean and tracking out to road right-of-way does not occur for the duration of the project. Pedestrian access route to be maintained at all times.
6. Protect all bio retention facilities, rain gardens, and permeable pavement from sedimentation through installation and maintenance of erosion and sediment control BMPs. Restore permanent BMPs to their fully functioning condition if they accumulate sediment during construction.
7. Prevent compaction of bio retention facilities and rain gardens by excluding construction equipment and foot traffic.
8. The ESC facilities shown on this plan must be constructed prior to or in conjunction with all clearing and grading so as to ensure that the transport of sediment to surface waters, drainage systems, and adjacent properties is minimized.

## STRUCTURAL NOTES

## RECOMMENDED CONSTRUCTION SEQUENCE



3. Hold the erosion sedimentation control pre-construction meeting on site.
2. Conduct an initial erosion sedimentation control (IESC) site inspection.
3. Hold the pre-construction meeting at the City, virtually, or on site.
4. Post a sign with name and phone number of the site's ESC supervisor.
5. Flag and/or fence the clearing limits as required by the approved plans, permit conditions; or SEPA conditions.
6. Inspection and sign-off of the clearing limits by a Public Works inspector.
7. Install catch basin protection as required.
8. Grade and install construction entrance(s).
9. Install perimeter protection (silt fence, brush barrier, etc.).
10. Clearly mark locations of proposed bio retention facilities, rain gardens, and permeable pavement and install ESC BMPS to protect them from compaction and sedimentation.
11. Construct sediment ponds and traps.
12. Inspection of ESC measures by a Public Works inspector prior to commencement of grading activity.
13. Grade and stabilize construction roads.
14. Demolition of existing structures and site features.
15. Construct surface water controls (interceptor dikes, pipe slope drains, etc.) Simultaneously with clearing and grading for project development.
16. Maintain erosion control measures in accordance with City of SeaTac standards and manufacturer's recommendations.
17. Relocate surface water controls and erosion control measures or install new measures so that as site conditions change the erosion and sediment control is always in accordance with the City of SeaTac erosion and sediment control standards.
18. Cover all areas that will be unworked for more than seven days during the dry season or two days during the wet season with straw, wood fiber mulch, compost, plastic sheeting or equivalent.
19. Stabilize all areas that reach final grade within seven days.
20. Upon completion of the project, all disturbed areas must be stabilized and best management practices removed as appropriate.
21. Prior to final inspection approval, conduct an infiltration test for any bio retention or permeable pavement installation to confirm that the permanent BMPS were not impacted by construction activities. If needed, restore or replace bio retention or permeable pavement BMPS, so that they are fully functioning upon completion of construction activities.



<p>CITY OF SEATAC PUBLIC WORKS DEPARTMENT 4800 SOUTH 188TH STREET, SEATAC, WASHINGTON 98188</p> <p><b>EXAMPLE SINGLE FAMILY, ADU AND ADDITION</b></p>	<p><b>COVER SHEET</b></p>	<p>REV. 00</p> <p>PAGE 1/</p>
---	---------------------------	-------------------------------



LAST SAVED BY: GRACE AMUNDSEN BARNKOW DATE: 3/1/2022 4:32:30 PM  
DRAWING ID: C:\USERS\BARNKOW\DOCUMENTS\COMBO PERMIT\20220210 CAD FOR COMBO PERMIT.

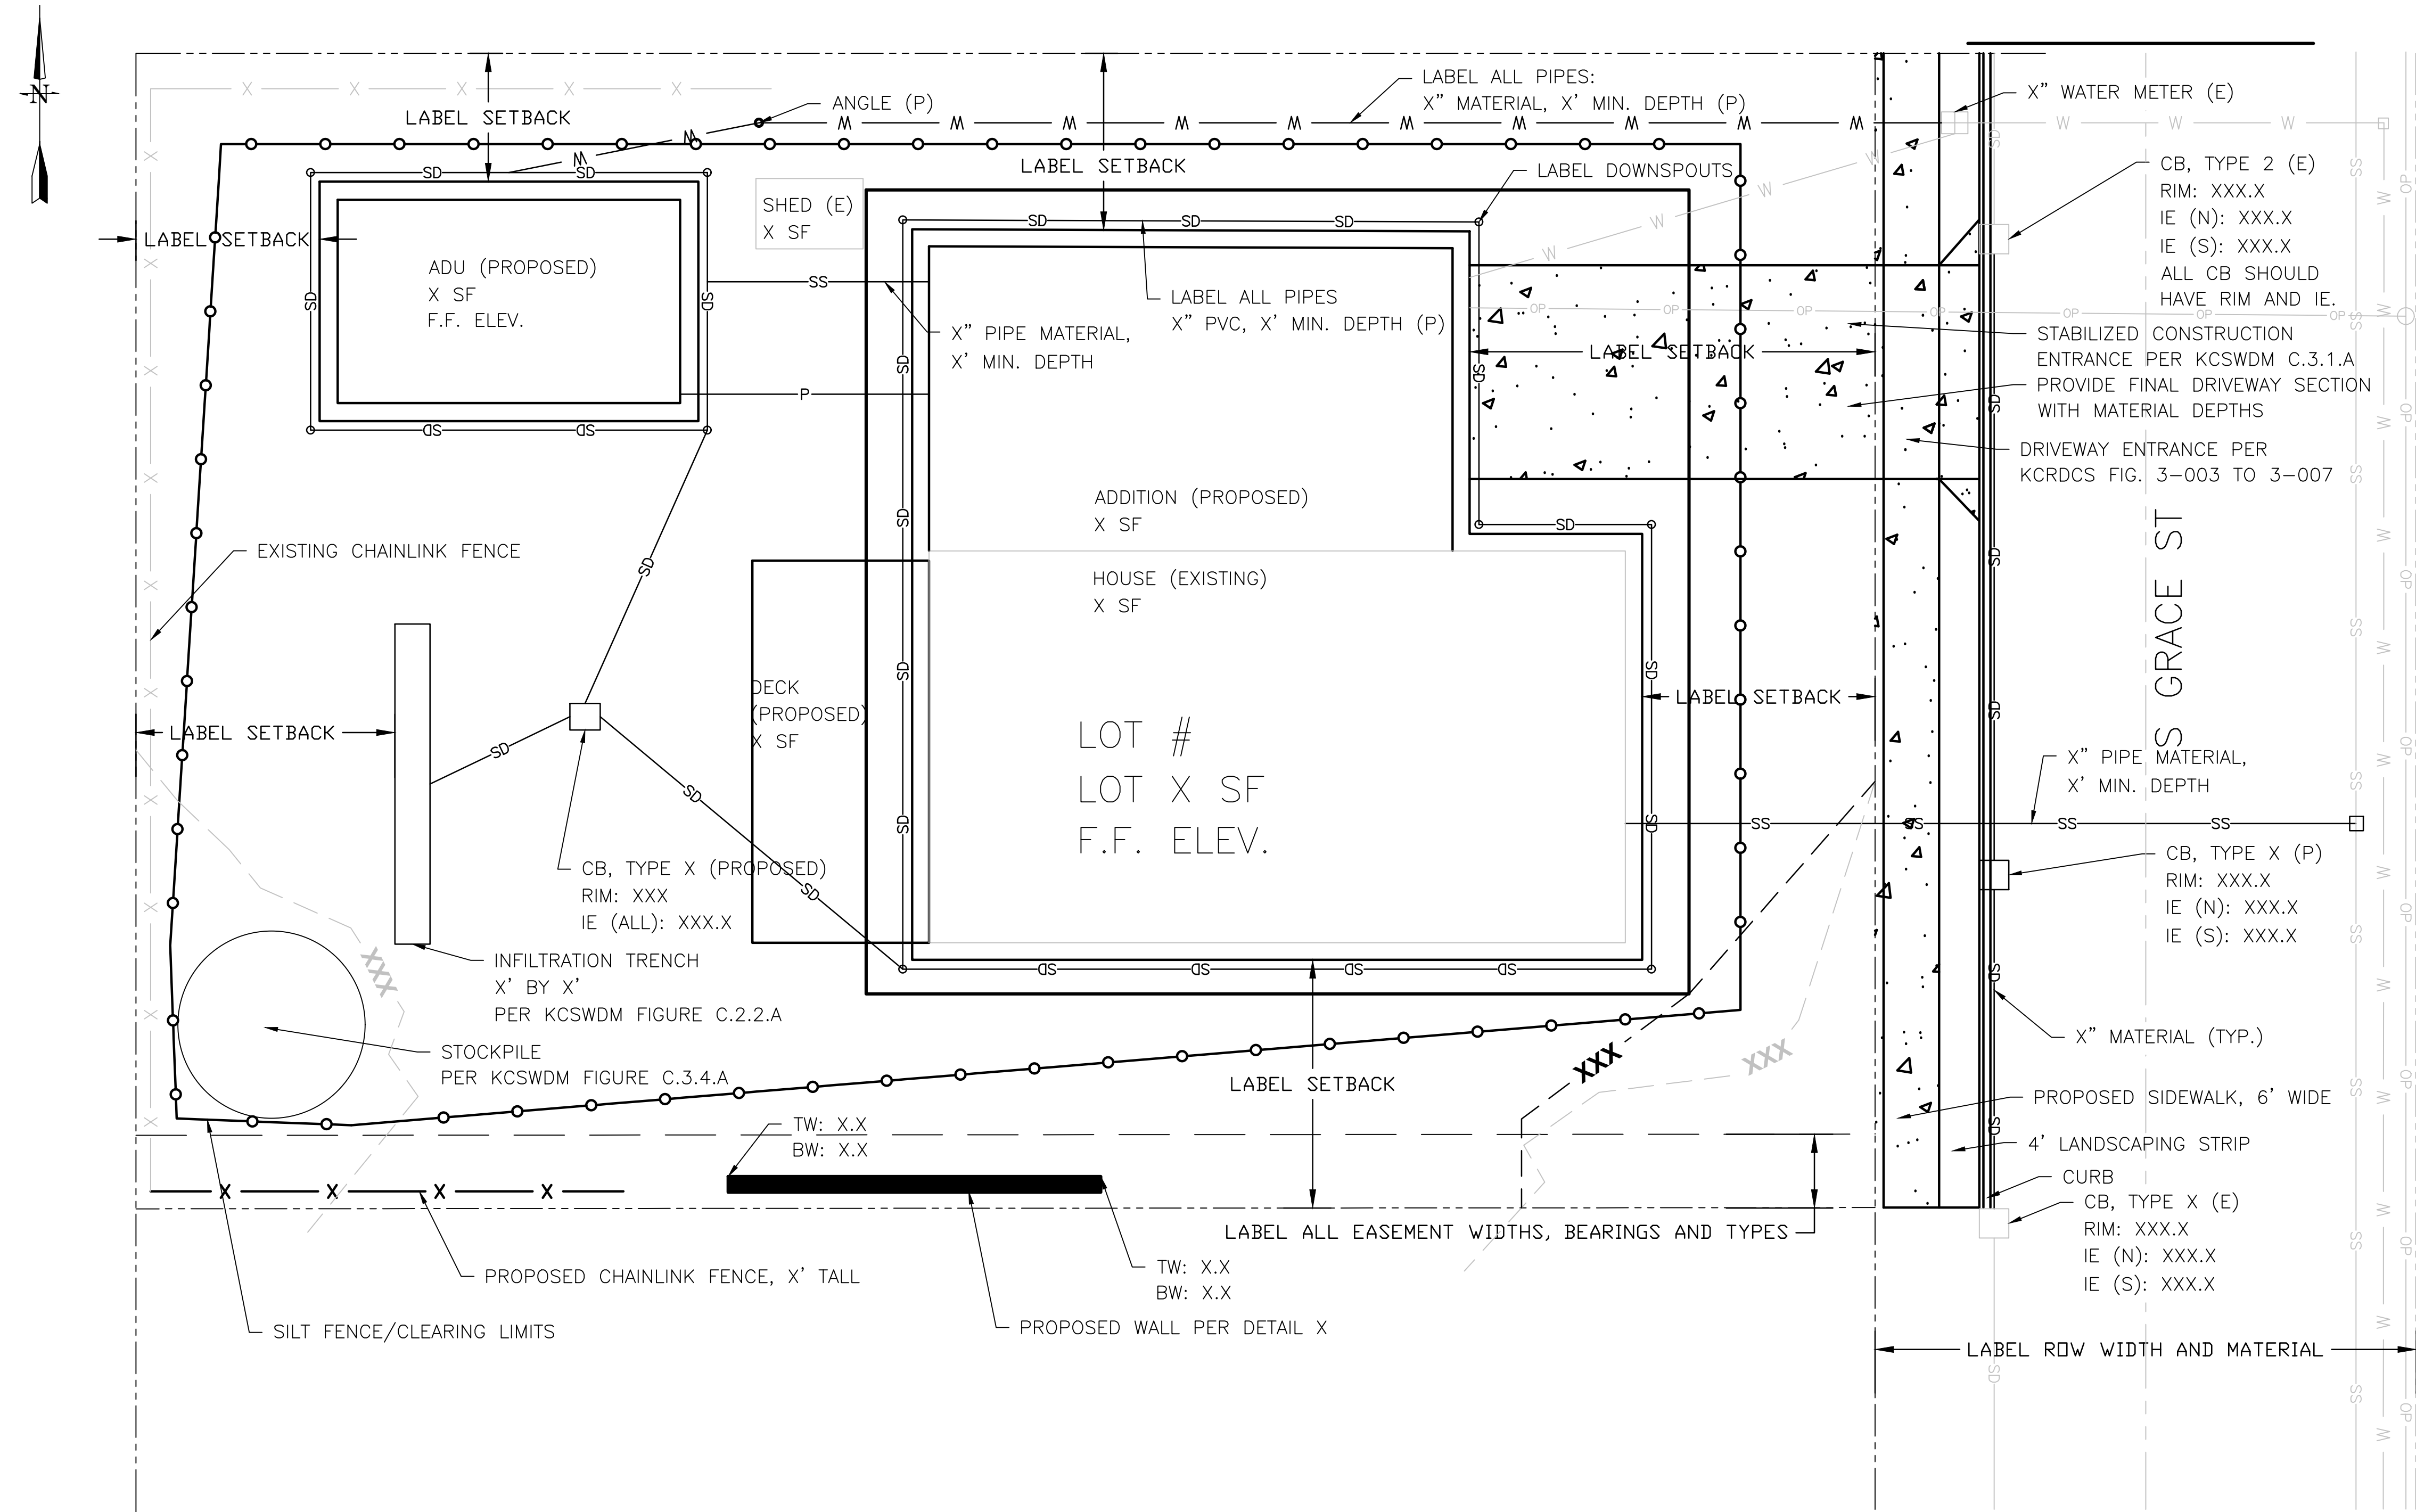

#### PROJECT SPECIFIC NOTES

1. THE MOST RECENT VERSION OF THE CITY OF SEATAC SOIL AMENDMENT STANDARDS APPLY TO ANY DISTURBED AREA NOT BEING MADE IMPERVIOUS.
2. KCRDCS AND KCSWDM FIGURES REFERENCED IN THE PLANS SHOULD BE PROVIDED WITH THE SITE PLAN (TYPICAL).

DESIGNED BY: ENGINEERING REVIEW DIVISION  
DRAWN BY: ENGINEERING REVIEW DIVISION  
CHECKED BY:  
DATE: August 18th, 2022



CITY OF SEATAC PUBLIC WORKS DEPARTMENT  
4800 SOUTH 188TH STREET, SEATAC, WASHINGTON 98188

#### EXAMPLE SINGLE FAMILY, ADU AND ADDITION

#### SITE PLAN

PLACE FOR CITY STAMPS

CUT VOLUME: X CY  
FILL VOLUME: X CY  
DISTURBED AREA: X ACRES  
EXISTING IMPERVIOUS AREA: X SF  
NEW IMPERVIOUS ARE: X SF  
REPLACED IMPERVIOUS AREA: X SF  
TOTAL IMPERVIOUS AREA: X SF

[SIZING CALCULATIONS FOR WATER QUALITY, FLOW  
CONTROL, AND OTHER STORMWATER FEATURES  
SHOULD BE HERE]

#### LEGEND

---	ROW/PROPERTY LINES
SS	PROPOSED SANITARY SEWER
SS	EXISTING SANITARY SEWER
W	PROPOSED WATER
W	EXISTING WATER
SD	PROPOSED STORM
SD	EXISTING STORM
---	PROPOSED EASEMENT
P	PROP. UNDERGROUND POWER
OP	EX. OVERHEAD POWER
X	PROPOSED FENCE
X	EXISTING FENCE
---	EXISTING CONTOURS
---	PROPOSED CONTOURS
---	SILT FENCE/CLEARING LIMITS
---	ROADWAY CENTERLINE
---	PROPOSED SIDEWALK
---	PROPOSED WALL
□	PROPOSED CATCH BASIN
□	EXISTING CATCH BASIN
□	EXISTING SANITARY SEWER MANHOLE
□	EXISTING WATER METER

REV.	DATE	DRWN	CHKD	DESCRIPTION

REV. 00

PAGE 2 / 2